


**ELEVATION**

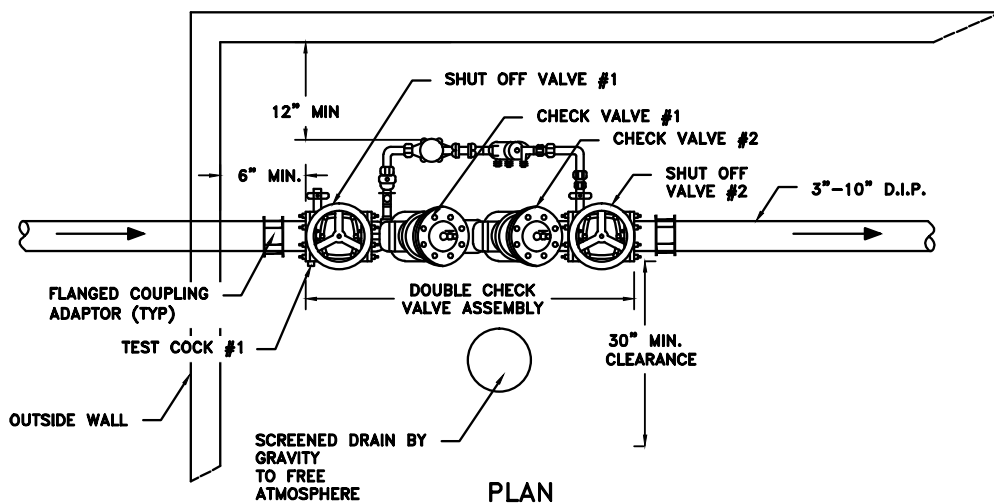

**PLAN**

## >2" DOUBLE CHECK VALVE BACKFLOW PREVENTER-INTERIOR

**NOTES:**

1. ALL PIPE 3" - 10" SHALL BE D.I.P. FROM THE TAP AT THE MAIN TO 5' PAST SHUT OFF VALVE #2.
2. RESTRAINED JOINTS SHALL BE WITH MEGA LUG RESTRAINTS OR APPROVED EQUAL.
3. DRAIN PIPE SHALL BE SIZED ACCORDING TO THE MANUFACTURERS FLOW CURVE TO DETERMINE THE MAXIMUM DISCHARGE RATE.

	REVISIONS 12/13 - MSG EDITS 01/16 - MSG EDITS	<b>AMERICAN WATER STANDARD          CIVIL          BACKFLOW PREVENTER-INTERIOR          &gt;2" DOUBLE CHECK VALVE</b>
		AMERICAN WATER MILITARY SERVICES GROUP MT LAUREL, NJ 08054
		AMERICAN WATER M.S.G. 330 FELLOWSHIP ROAD MT LAUREL, NJ 08054
		<b>AMERICAN WATER.</b>
		DRAWN BY JRQ PROJECT ENG'R PDK APPROVED
		DATE 12-06-11 PROJECT IP
		USE DIMENSIONS ONLY SCALE N.T.S.
		USE APPROVED DRAWINGS ONLY FOR CONSTRUCTION PURPOSES
		<b>MSG-W-20</b>

FINAL

MSG-W-20