



WATER CROSSINGS

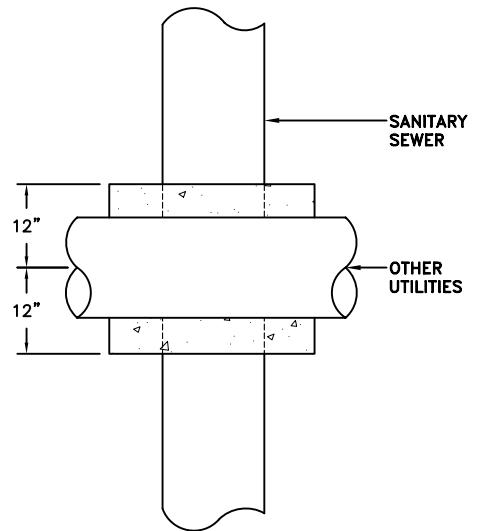

UTILITY CROSSINGS

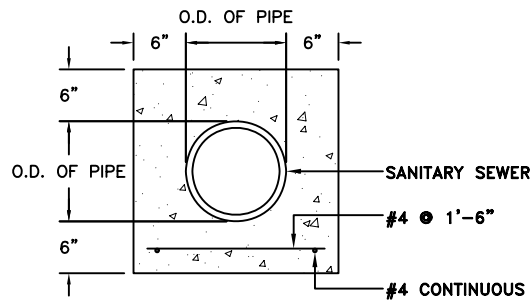

ENCASEMENT SECTION

## CONCRETE ENCASEMENT DETAIL

**NOTES:**

1. PROVIDE CONCRETE ENCASEMENT WHEN MINIMUM SEPARATION REQUIREMENTS CAN NOT BE MET OR AS DIRECTED BY AMERICAN WATER.
2. STEEL REINFORCEMENT TO BE PROVIDED AT POINT OF UTILITY CROSSING OR AS DIRECTED BY AMERICAN WATER.

|           |  |
|-----------|--|
| REVISIONS | AMERICAN WATER MILITARY SERVICES GROUP<br>CIVIL<br>CONCRETE ENCASEMENT<br>DETAIL |
|           | AMERICAN WATER MILITARY SERVICES GROUP<br>MT LAUREL, NJ 08054                    |
|           | AMERICAN WATER M.S.G.<br>330 FELLOWSHIP ROAD<br>MT LAUREL, NJ 08054<br>          |
|           | DRAWN BY J. ABRERA<br>PROJECT ENG'R J. DERUSSO<br>APPROVED                       |
|           | DATE 04-30-2010<br>PROJECT N/A<br>USE DIMENSIONS ONLY<br>SCALE N.T.S.            |
|           | USE APPROVED DRAWINGS ONLY<br>FOR CONSTRUCTION PURPOSES                          |
|           | MSG-ST-07  |