


ELEVATION

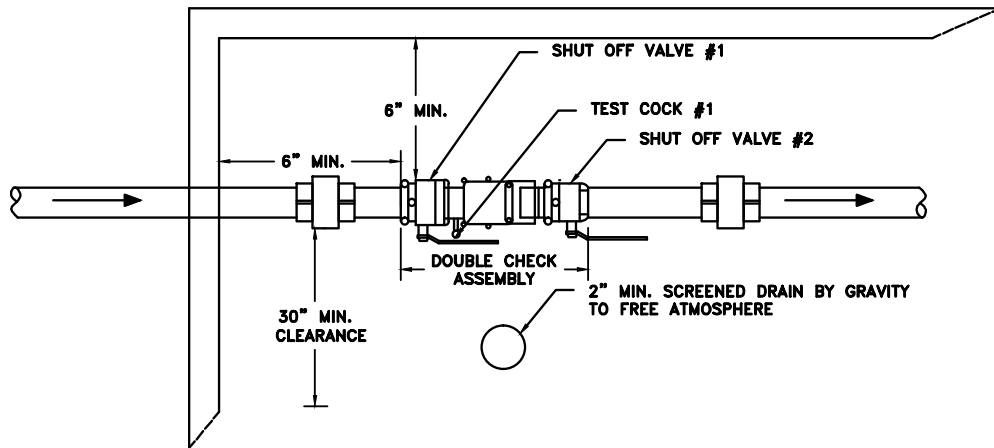

PLAN

3/4"–2" DOUBLE CHECK VALVE BACKFLOW PREVENTER–INTERIOR

NOTE:

1. AW APPROVED DCVA INCLUDES SHUT OFF VALVES #1 AND #2 AS PART OF THE ASSEMBLY. NO SUBSTITUTIONS SHALL BE PERMITTED.
2. DRAIN PIPE SHALL BE SIZED ACCORDING TO THE MANUFACTURERS FLOW CURVE TO DETERMINE THE MAXIMUM DISCHARGE RATE.

	REVISIONS 12/13 – MSG EDITS 01/16 – MSG EDITS	AMERICAN WATER STANDARD CIVIL BACKFLOW PREVENTER–INTERIOR 3/4"–2" DOUBLE CHECK VALVE
		AMERICAN WATER MILITARY SERVICES GROUP MT LAUREL, NJ 08054
		<div style="display: flex; justify-content: space-between;"> <div style="font-size: small;"> AMERICAN WATER M.S.G. 330 FELLOWSHIP ROAD MT LAUREL, NJ 08054 </div> <div style="font-size: 2em; font-weight: bold;">★</div> <div style="font-size: small;"> AMERICAN WATER. USE DIMENSIONS ONLY SCALE N.T.S. </div> </div>
	DRAWN BY JRQ PROJECT ENG'R PDK APPROVED	DATE 12-08-11 PROJECT IP
	USE APPROVED DRAWINGS ONLY FOR CONSTRUCTION PURPOSES	MSG–W–19

FINAL

MSG–W–19